


D1

CODE:PSBEN 5024Cv.1.1/VIEN**TYPE:PSBEN 27,6V/5A/2x17Ah/ENbuffer, switched mode power supply unit

BLACK POWER



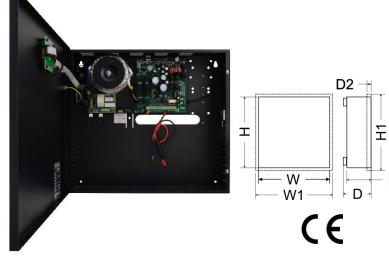

This product is suitable for the systems designed in compliance with the EN 50131-6 grade 1, 2 or 3 and II environmental class."

Functional requirements	Requirements of EN 50131-6			PSBEN5024C
	Grade 1	Grade 2	Grade 3	
EPS network absence	YES	YES	YES	YES
Battery low voltage	YES	YES	YES	YES
Protection against full battery discharge	-	-	YES	YES
Battery fault	-	-	YES	YES
No battery charge	-	-	YES	YES
Output low voltage	-	-	YES	YES
Output high voltage	-	-	YES	YES
PSU fault	-	-	YES	YES
Surge protection	-	-	YES	YES
Short circuit protection	YES	YES	YES	YES
Overload protection	YES	YES	YES	YES
Output fuse activation	-	-	-	YES
Battery fuse fault	-	-	-	YES
EPS technical output	YES	YES	YES	YES
APS technical output	YES	YES	YES	YES
PSU technical output	YES	YES	YES	YES
Collective failure input	-	-	-	YES
Remote battery test	-	-	-	YES
Tamper resistance – enclosure opening	YES	YES	YES	YES
Tamper resistance – detachment from the mounting surface	-	-	YES	YES

PSBEN/LED series power supply unit

Buffer, switched mode power supply unit 27,6V DC

Pulsar

PSU features:

- EN50131-6 compliance, 1÷3 grades and II environmental class
- mains supply of 230VAC
- uninterrupted voltage of 27,6VDC
- fitting battery: 2x17Ah/12V
- high efficiency 83%
- PSU current efficiency:
 - 1,4A for grades 1, 2 *
 - 0,56A for grades 3 **
 - 5A for general use ***
 - (see: chapter 3.1)
- low level of voltage ripple
- microprocessor-based automation system
- intelligent management of PSU's output power level
- SERIAL' communication port with implemented MODBUS RTU protocol
- remote monitoring (option: Wi-Fi, Ethernet, RS485, USB)
- free program 'PowerSecurity' for monitoring the PSU operation parameters
- load current control
- output voltage control
- output fuse status control
- dynamic battery test
- battery circuit continuity control
- battery voltages control
- battery fuse status control
- battery charge and maintenance control
- deep discharge battery protection (UVP)
- battery overcharge protection
- battery output protection against short circuit and reverse polarity connection

- jumper selectable battery charging current 0,6A/1,5A/2,2A/3A
- remote battery test (additional module required)
- START button for battery activation
- STOP button for disconnecting during battery-assisted operation
- optical indication LED panel
 - output current readings
 - output voltage readings
 - · failure codes with history
- optical indication of PSU overload OVL
- acoustic indication of failure
- adjustable times indicating AC power failure
- technical inputs/outputs with galvanic isolation
- EXT IN input of collective failure
- EPS technical output indicating AC power loss
- PSU technical output indicating PSU failure
- · APS technical output indicating battery failure
- internal memory of PSU operating status
- protections:
 - SCP short circuit protection
 - OLP overload protection
 - OHP overheat protection
 - OVP over voltage protection
 - surge protection
 - against tampering: unwanted opening of the
 - enclosure or detachment from the mounting surface
- convectional cooling
- warranty 5 year from the production date

DESCRIPTION

The buffer power supply is designed in accordance with the requirements of the EN 50131-6 standard, grade $1\div3$ and II environmental class. It is intended for an uninterrupted supply of alarm system devices requiring stabilized voltage of 24V/DC (+/-15%).

Depending on a required protection level of the alarm system in the installation place, the PSU efficiency and the battery charging current should be set as follows:

* Grade 1, 2 - standby time 12h

Output current 1,4A + 3A battery charge

** Grade 3 - standby time 30h if the faults of the main power source are reported to the Alarm Receiving Centre - ARC (in accordance with 9.2 – EN 50131-1 standard).

Output current 0,56A + 3A battery charge

- standby time 60h if the faults of the main power source are reported to the Alarm Receiving Centre - ARC (in accordance with 9.2 – EN 50131-1 standard).

Output current 0,28A + 3A battery charge

*** General use – if the PSU is not mounted in an installation complaint with the EN-50131 standard, the acceptable current efficiency amounts to:


- 1. Output current 5A + 0,6A battery charge
- 2. Output current 4,1A + 1,5A battery charge
- 3. Output current 3,4A + 2,2A battery charge
- 4. Output current 2,6A + 3A battery charge
- Total current of the receivers + battery: 5,6A max.

In case of power decay, a battery back-up is activated immediately. The PSU is housed in a metal enclosure (color: RAL 9005 - black) with battery space for a 2x17Ah/12V battery. It is fitted with micro switches indicating unwanted door opening (front panel) and detachment from the mounting surface.



SPECIFICATIONS			
PSU type	A, protection class 1+3, II environmental class		
Mains supply	230V/AC 50Hz (-15%/+10%)		
Current consumption	1,1 A		
PSU's power	155W		
Efficiency	83%		
Output voltage	22V÷27,6V DC – buffer operation		
2	20V+27,6V DC – battery-assisted operation		
Output current	 for grades 1, 2: Io = 1,4A + 3A battery charging for grade 3: Io = 0,56A + 3A battery charging - (connection with ARC required, compliant with 9.2 - EN 50131-1) Io = 0,28A + 3A battery charging for general use: Io = 5A + 0,6A battery charging Io = 4,1A + 1,5A battery charging 		
	Io = 3,4A + 2,2A battery charging Io = 2,6A + 3A battery charging		
Output voltage adjustment range	24V÷29V		
Ripple voltage	160 mV p-p max.		
Current consumption by the PSU systems during	I = 22mA		
batter-assisted operation			
Battery charging current	0,6A / 1,5A/2,2A/3A –I _{BAT} jumper selectable		
Short circuit protection SCP	Electronic – current limitation and / or F _{BAT} fuse failure in the battery circuit (requires fuse replacement) Automatic return		
Overload protection OLP	Program - equipment		
Surge protection	varistors		
Over voltage protection OVP	U>31V, disconnection of the output voltage, automatic return (AUX+ disconnection)		
Battery circuit protection SCP and reverse polarity connection	T6,3 A- current limiting, F _{BAT} fuse (failure requires fuse-element replacement)		
Deep discharge battery protection UVP	U<20V (± 2%) – disconnection (-BAT) of the battery, configuration with jumper P_{BAT}		
Indication of opening the cover of the power supply or detachment from the ground	Micro switch TAMPER		
Technical outputs: - EPS FLT; output indicating AC power failure	- type – electronic, max 50mA/30V DC, galvanic isolation 1500V _{RMS} - time lag, approx. 5s/140s/17m/2h 20m (+/-5%)		
- APS FLT; output indicating battery failure	- type – electronic, max 50mA/30V DC, galvanic isolation 1500V _{RMS}		
- PSU FLT; output indicating PSU failure	- type – electronic, max 50mA/30V DC, galvanic isolation 1500V _{RMS}		
EXT IN technical input	Voltage 'on' – 10÷30V DC Voltage 'off' – 0÷2V DC Level of galvanic isolation: 1500V _{RMS}		
Optical indication:	LEDs on the PSU's pcb, LED panel output current readings output voltage readings failure codes with history		
Additional accessories (not included)	 interface USB-TTL 'INTU'; communication: USB-TTL interface RS485 'INTR'; communication: RS485 interface USB-RS485 'INTUR'; communication: USB-RS485 interface Ethernet 'INTE'; communication: Ethernet interface WiFi "INTW'; wireless communication: Wi-Fi interface RS485-Ethernet "INTRE'; communication: RS485- Ethernet interface RS485-WiFi "INTRW'; wireless communication: RS485- 		
Operating conditions	2nd environmental class, -10 °C+40 °C		
Enclosure	Steel plate DC01 1mm, colour RAL 9005 (black)		
Enclosure dimensions	400 x 350 x 98 (WxHxD) [mm] (+/- 2)		
Net/gross weight	7,1/7,6 kg		
Fitting battery	2x17Ah/12V (SLA) max. 380 x 165 x 85mm (WxHxD) max D		
Closing	Cheese head screw x2 (at the front), lock assembly possible		
Deklarations, warranty	CE, RoHS, 5 year from the production date		
Notes	The enclosure does not adjoin the assembly surface so that cables can be led.		
1000	Convectional cooling.		



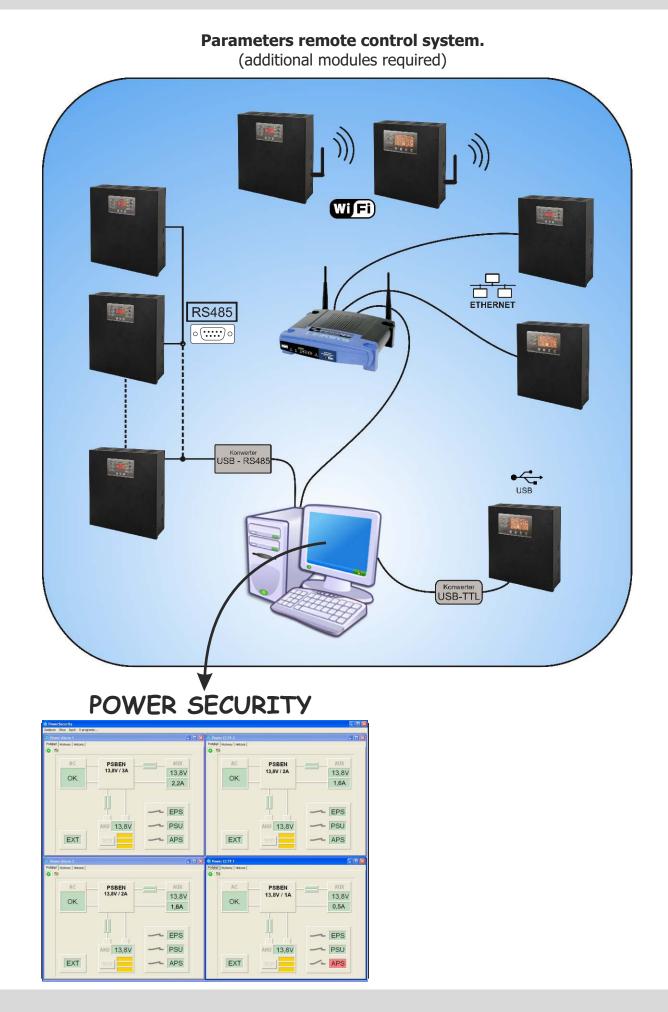




Remote monitoring (options: Wi-Fi, Ethernet, RS485, USB).

The PSU has been adjusted to operate in a system that requires a remote control of the parameters in a monitoring centre. Transmitting data concerning PSU status is possible due to an additional, external communication module responsible for communication in Wi-Fi, Ethernet or RS485 standard. The USB –TTL interface enables the connection between the PSU and the computer.

Communication via the USB-TTL interface.


The easiest way of communication between the PSU and the computer is provided by the USB-TTL "INTU" interface. This interface allows direct connection between the computer and the PSU and is recognizable by the operating system as a virtual COM port.

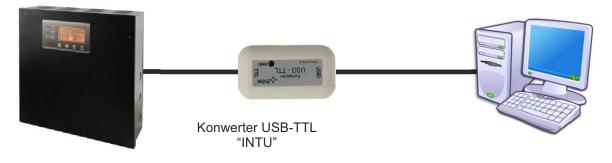


USB-TTL communication using the USB-TTL "INTU" interface.

RS485 network communication.

Another type of network communication is the RS485 communication using two-wire transmission path. To achieve this kind of data exchange, the PSU should be equipped with the additional RS485 TTL "INTR" interface, converting data from the PSU into the RS485 standard and the USB-RS485 "INTUR" interface, converting data from the RS485 network to the USB. Offered interfaces are galvanically isolated and protected against surges.

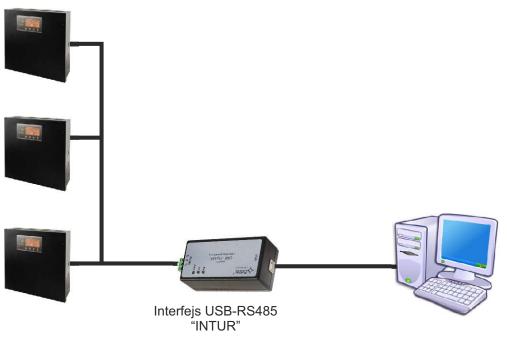







ETHERNET network communication.

Communication in the Ethernet network is possible due to the additional interfaces: Ethernet "INTE" and RS485-ETH "INTRE", according to the IEEE802.3 standard.

The Ethernet "INTE" interface features full galvanic isolation and protection against surges. It should be mounted inside the enclosure of the PSU.

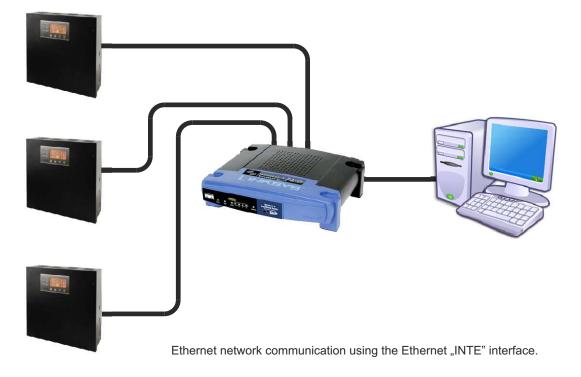

The RS485-WiFi "INTRE" interface is a device used to convert signals between the RS485 bus and the Wi-Fi network. For proper operation, the unit requires an external power supply in the range of 10÷30V DC e.g. drawn from a PSU of the PSBEN series. The physical connection of the interface takes place under galvanic isolation. The unit is mounted in a hermetic enclosure protecting against adverse environmental conditions.

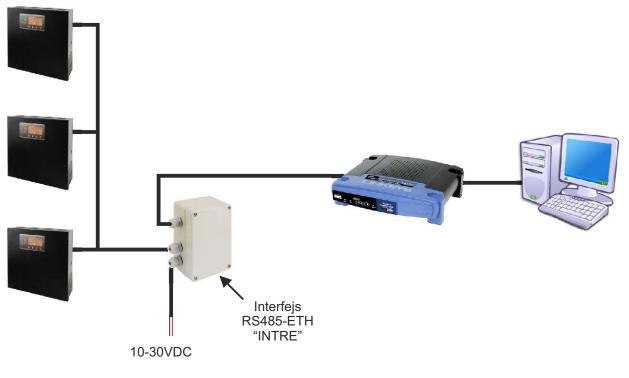


Ethernet network communication using the RS485 "INTRE" interface.


Pulsar

The Wi-Fi wireless communication.

The Wi-Fi wireless communication can be implemented on the basis of additional WI-Fi 'INTW' and RS485-WiFi interfaces, operating within 2,4GHz frequency band, according to the IEEE 802.11 bgn standard. The Wi-Fi "INTW" interface shall be mounted in a selected location inside the enclosure so that the antenna is exposed to the outside.

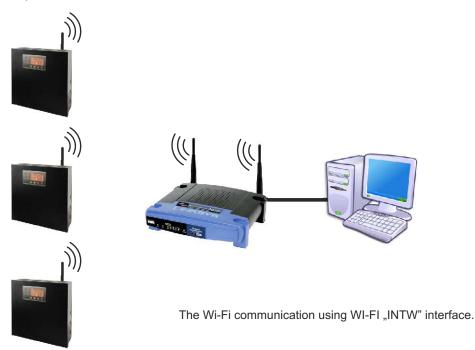

The RS485-WiFi "INTRW" interface is a device used to convert signals between the RS485 bus and the Wi-Fi network. For proper operation, the unit requires an external power supply in the range of 10÷30V DC e.g. drawn from a PSU of the PSBEN series. The physical connection of the interface takes place under galvanic isolation. The unit is mounted in a hermetic enclosure protecting against adverse environmental conditions.

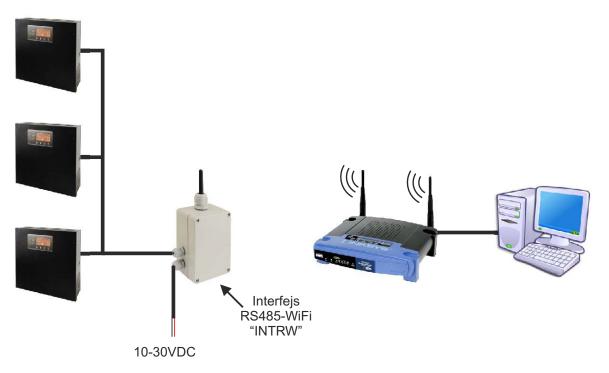

The Wi-Fi communication using the RS485-WIFI "INTRW" interface.

Pulsar

OPTIONAL POWER SUPPLY CONFIGURATIONS:

Buffer power supply PSBEN 27,6V/4x1A/2x17Ah/INTERFACE

 PSBEN 5024C + LB4 4x1A (AWZ575, AWZ576)+2x17Ah+INTERFACE

 Buffer power supply PSBEN 27,6V/24V/2,5A/2x17Ah/INTERFACE

 PSBEN 5024C + RN25024 (27,6V/24V)+2x17Ah+INTERFACE

 Buffer power supply PSBEN 27,6V/24V/4x0,5A/2x17Ah

 PSBEN 5024C + RN25024 (27,6V/24V)+2x17Ah+INTERFACE
 Buffer power supply PSBEN 27,6V/24V/4x0,5A/2x17Ah
 PSBEN 5024C + RN25024 (27,6V/24V)+LB4 4x0,5A (AWZ575, AWZ576)+2x17Ah